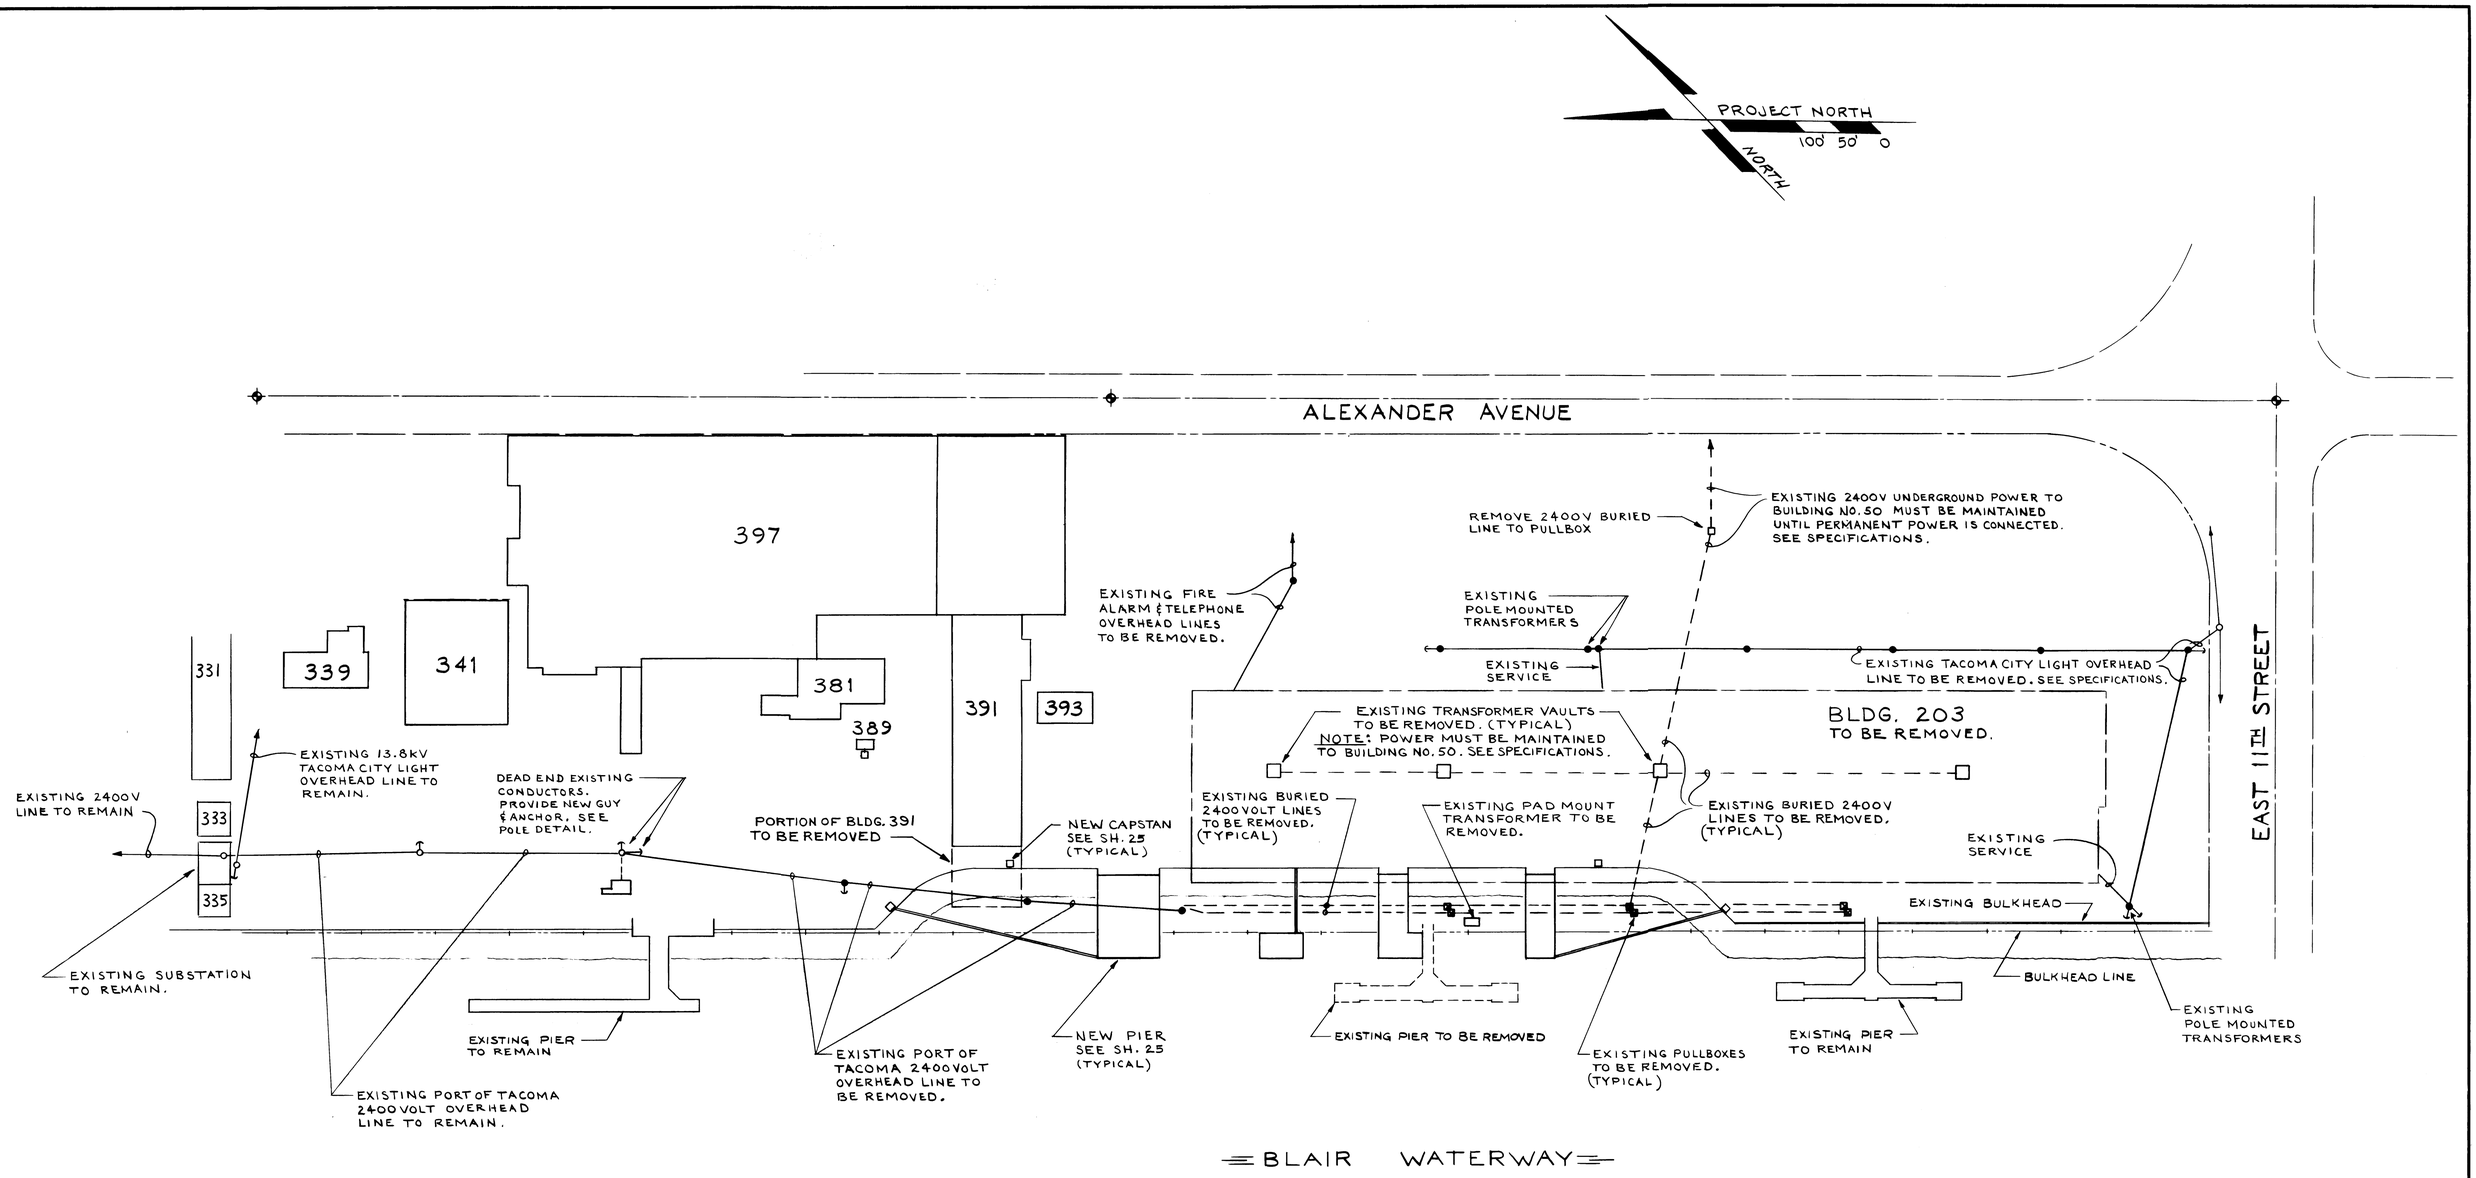

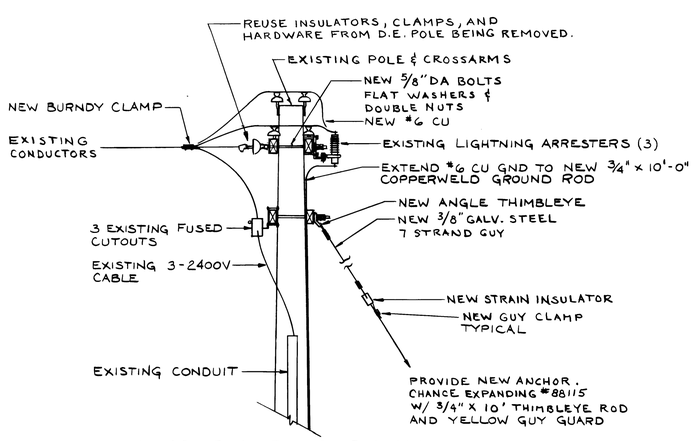

DEAD END POLE DETAIL

NO SCALE

LEGEND

- o EXISTING POLE TO REMAIN.
- ● EXISTING POLE TO BE REMOVED THIS CONTRACT.
- – – – EXISTING BURIED POWER LINE
- —●— EXISTING OVERHEAD LINE TO BE REMOVED THIS CONTRACT.
- —o— EXISTING PORT OF TACOMA OVERHEAD LINE TO REMAIN.
- ⊠ EXISTING PULLBOX TO BE REMOVED THIS CONTRACT.

NOTES

1. THE DRAWINGS ARE NOT COMPLETE WITHOUT THE ACCOMPANYING SPECIFICATIONS. SEE THE SPECIFICATIONS FOR FURTHER DESCRIPTION AND REQUIREMENTS OF THE WORK.
2. THE DRAWINGS AND SPECIFICATIONS ARE INTENDED TO INCLUDE ALL ITEMS NEEDED FOR COMPLETE DEMOLITION OF THE EXISTING ELECTRICAL INSTALLATION WITHIN THE DESCRIBED LIMITS AND ALL ITEMS NEEDED FOR NEW INSTALLATION INDICATED. PROVIDE ALL ITEMS.
3. REFER TO THE CIVIL, STRUCTURAL AND MECHANICAL DRAWINGS FOR ADDITIONAL DETAILS OF THE EXISTING AND NEW INSTALLATIONS WHICH AFFECT THE ELECTRICAL WORK.

4. The existing Tacoma City Light overhead power line along the east side of Building 203 shall be maintained in service to provide power for the Tacoma Boat steel yard until the contractor is notified by the Port of Tacoma that the line is no longer required. At that time, the contractor shall coordinate with Tacoma City Light for removal of the line. The contractor shall protect the line from damage until it is removed. △1

NW UTILITY CONSULTANTS, INC.
CONSULTING ENGINEERS
1402 47TH AVENUE EAST
TACOMA, WASHINGTON 98424

JOHN E. FIEDLER — STATE OF WASHINGTON — REGISTERED PROFESSIONAL ENGINEER

MARK	REVISION	BY	APP.	DATE
△1	REF. ADDENDUM NO. 2 - DATED 6/24/83			6/28/83

E1

DRAWN PAF
DATE APRIL, 83
CHECKED JEF
DATE 5-20-83
CHECKED
DATE
CONT. NO.

PORT OF TACOMA

ELECTRICAL SITE PLAN
TOTE PIER FACILITY
BLAIR WATERWAY - 1983

FIELD BOOK (S)
SCALE 1" = 100'
APPROVED 5/20/83 DATE
CHIEF ENGINEER
DRAWING NO. EP 3823-12
SHEET 24 OF 25