



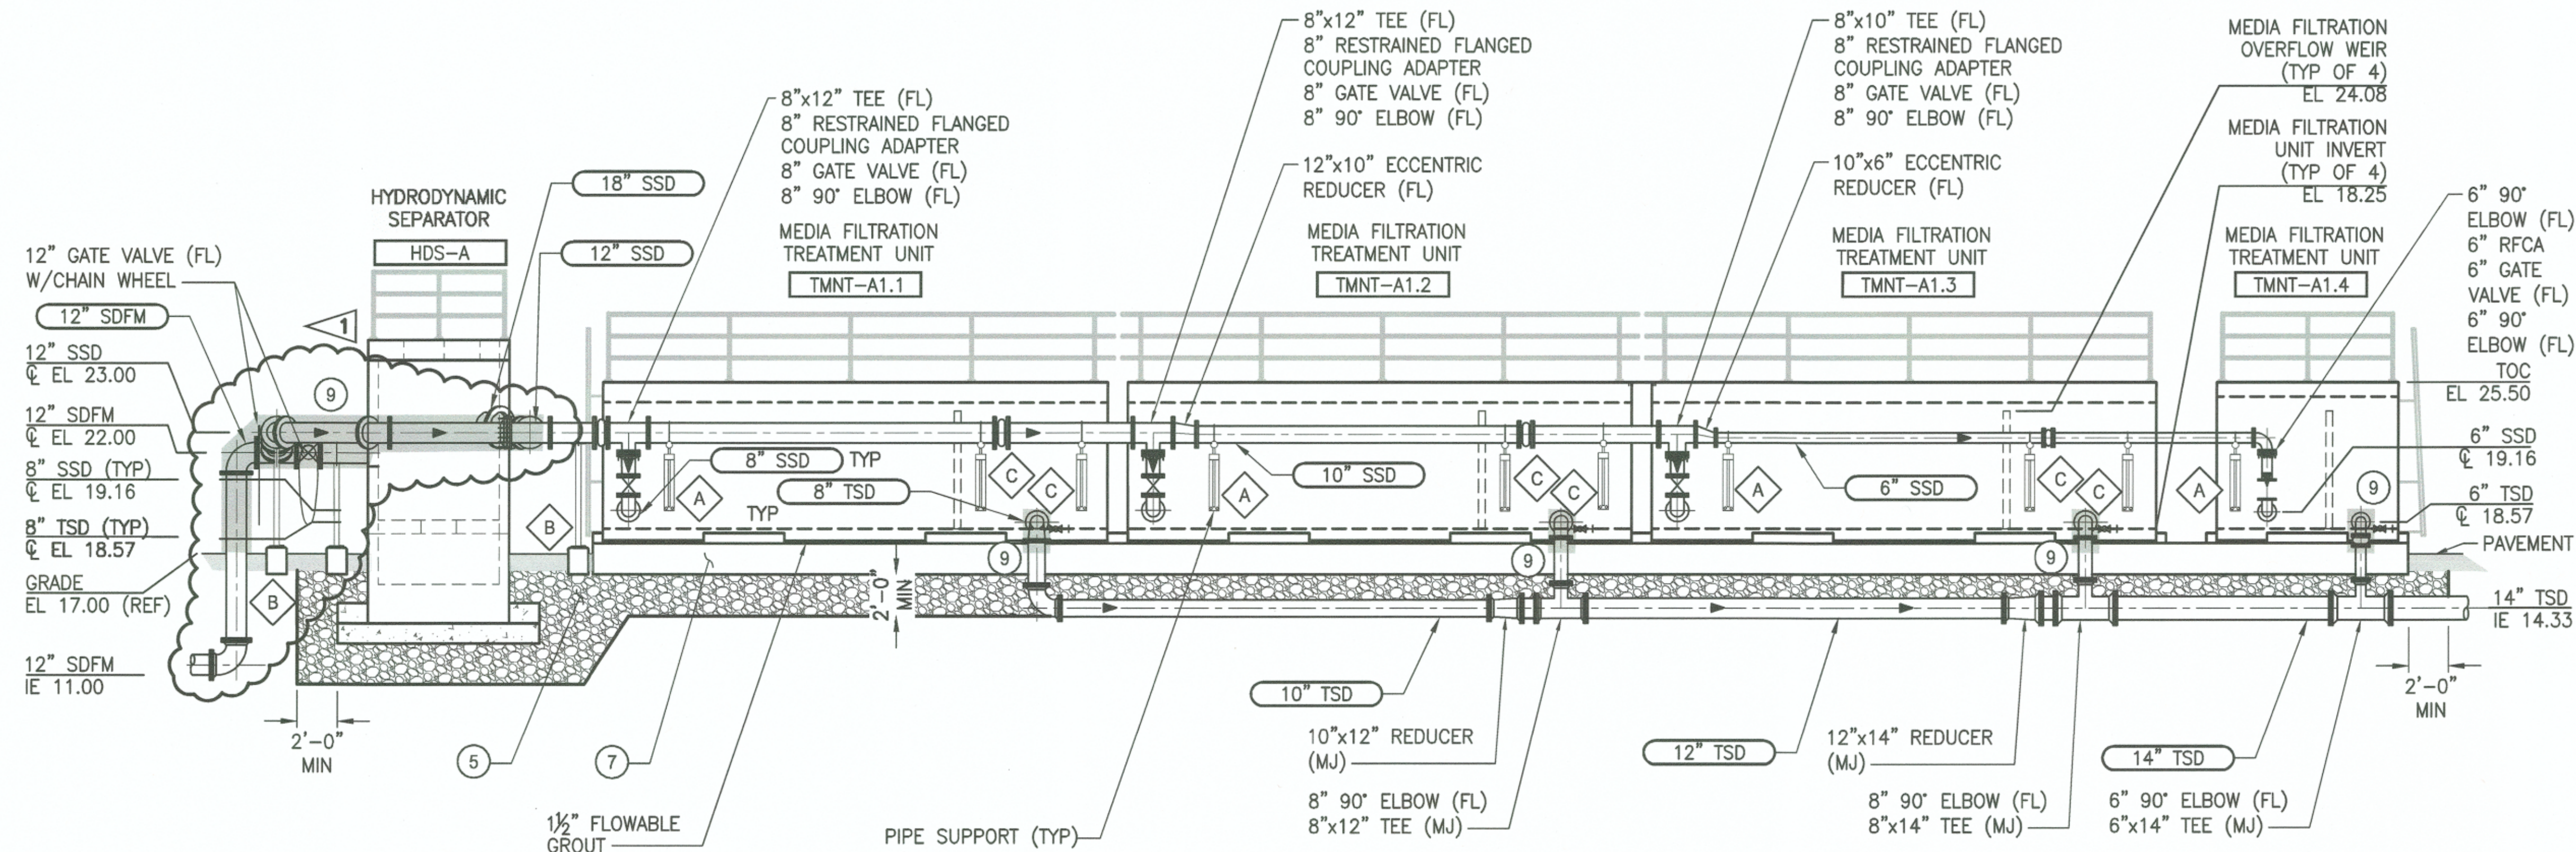

C
SECTION
SCALE: 3/16"=1'-0"

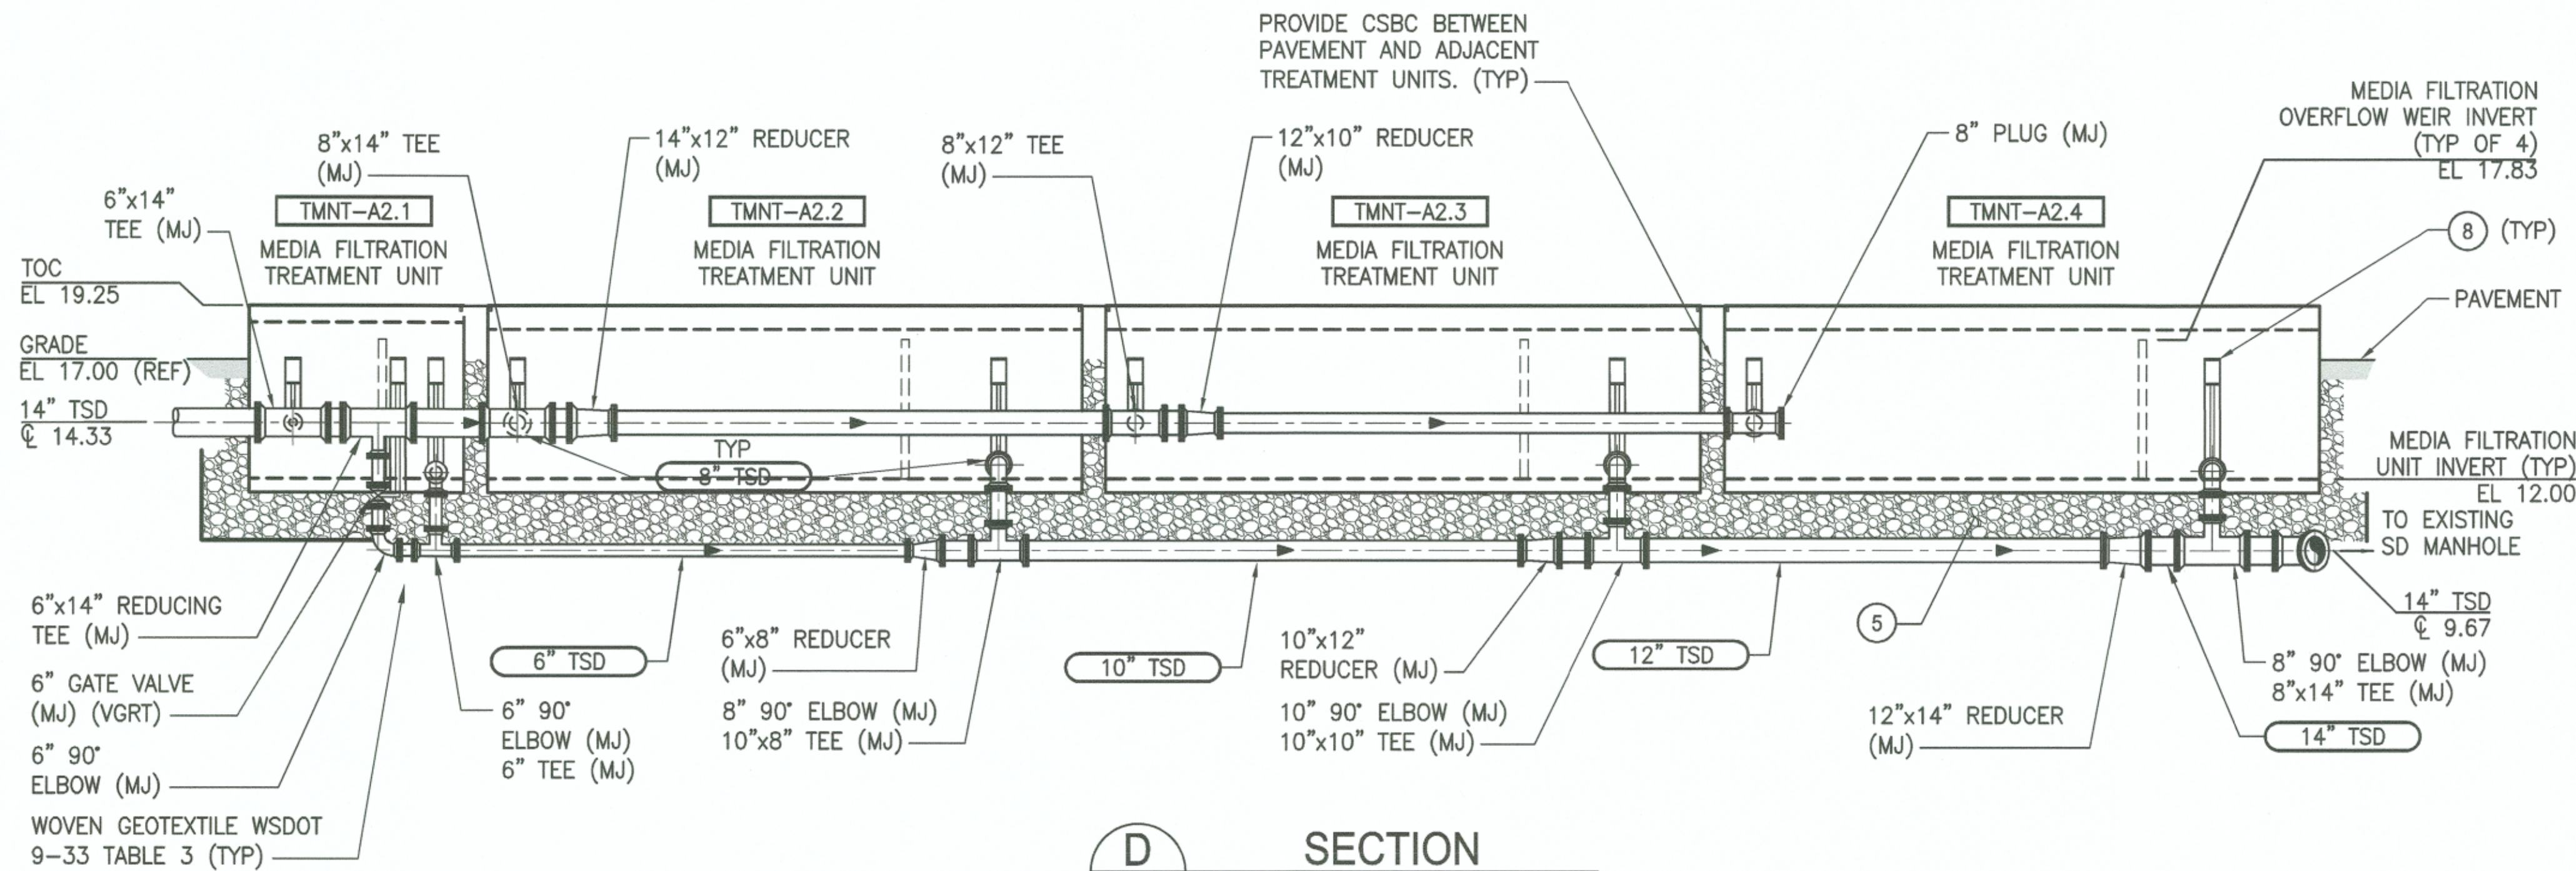

D
SECTION
SCALE: 3/16"=1'-0"

NOTES:

1. CONTRACTOR SHALL VERIFY DIMENSIONS, ELEVATIONS AND LOCATIONS PRIOR TO CONSTRUCTION.
2. PIPE SUPPORTS NOT SHOWN. PROVIDE PIPE SUPPORTS ON ALL PIPING WHERE NECESSARY. SEE LETTER ADJACENT TO SUPPORT FOR TYPE AS DETAILED ON SHEET S10, DETAIL 5.
3. ALL JOINTS AND COUPLINGS SHALL BE RESTRAINED.
4. ALL PIPE PENETRATIONS THROUGH WALLS AND SLABS REQUIRE MODULAR MECHANICAL SEALS WITH TIGHTENING BOLTS INSIDE STRUCTURE. SEE SHEET M10, DETAIL 5.
5. CSBC, SEE SPECIFICATIONS FOR MATERIAL AND INSTALLATION REQUIREMENTS.
6. SEE SHEET M01 FOR OWNER SUPPLIED MATERIAL.
7. CAST-IN-PLACE CONCRETE PAD TO 1'-0" BELOW GRADE. SEE STRUCTURAL FOR PAD DETAILS.
8. ALL BURIED VALVES SHALL BE PROVIDED WITH VALVE STEM EXTENSIONS CASING TUBES, VALVE BOXES, AND 2" SQUARE NUT WITH POSITION INDICATOR. SEE DETAIL 1, SHEET M10.
9. HEAT TRACING, INSULATION, AND JACKETING TO BE APPLIED TO PIPES INDICATED WITH HATCHING. SEE ELECTRICAL FOR CIRCUITING AND CONTROLLER INFORMATION.

LEGEND:

- HEAT TRACE
- PIPE SUPPORT TYPE

6583 M05 SH 32 OF 47 CON/CONS: 070664 M ID: 201024.01 PHASE: BID SET	WEST SITCUM STORMWATER TREATMENT MECHANICAL SECTION - BASIN A	APPROVED: <i>Jana L. ...</i> 5-16-18	JSL APR 2018 CHECKED BY: JEM APR 2018 DATE: APR 2018		Port of Tacoma P.O. BOX 1887 TACOMA, WA 98401 P 360.377.0014 WWW.PARAMETRIX.COM	BY: JEM	DATE: 5-16-18
		PRINTED BY: peterden May 16, 2018	REVISION: 4			DP	
		PROJECT ADDRESS: ONE SITCUM PLAZA	ADDENDUM				
		TACOMA, WA 98401-1837					